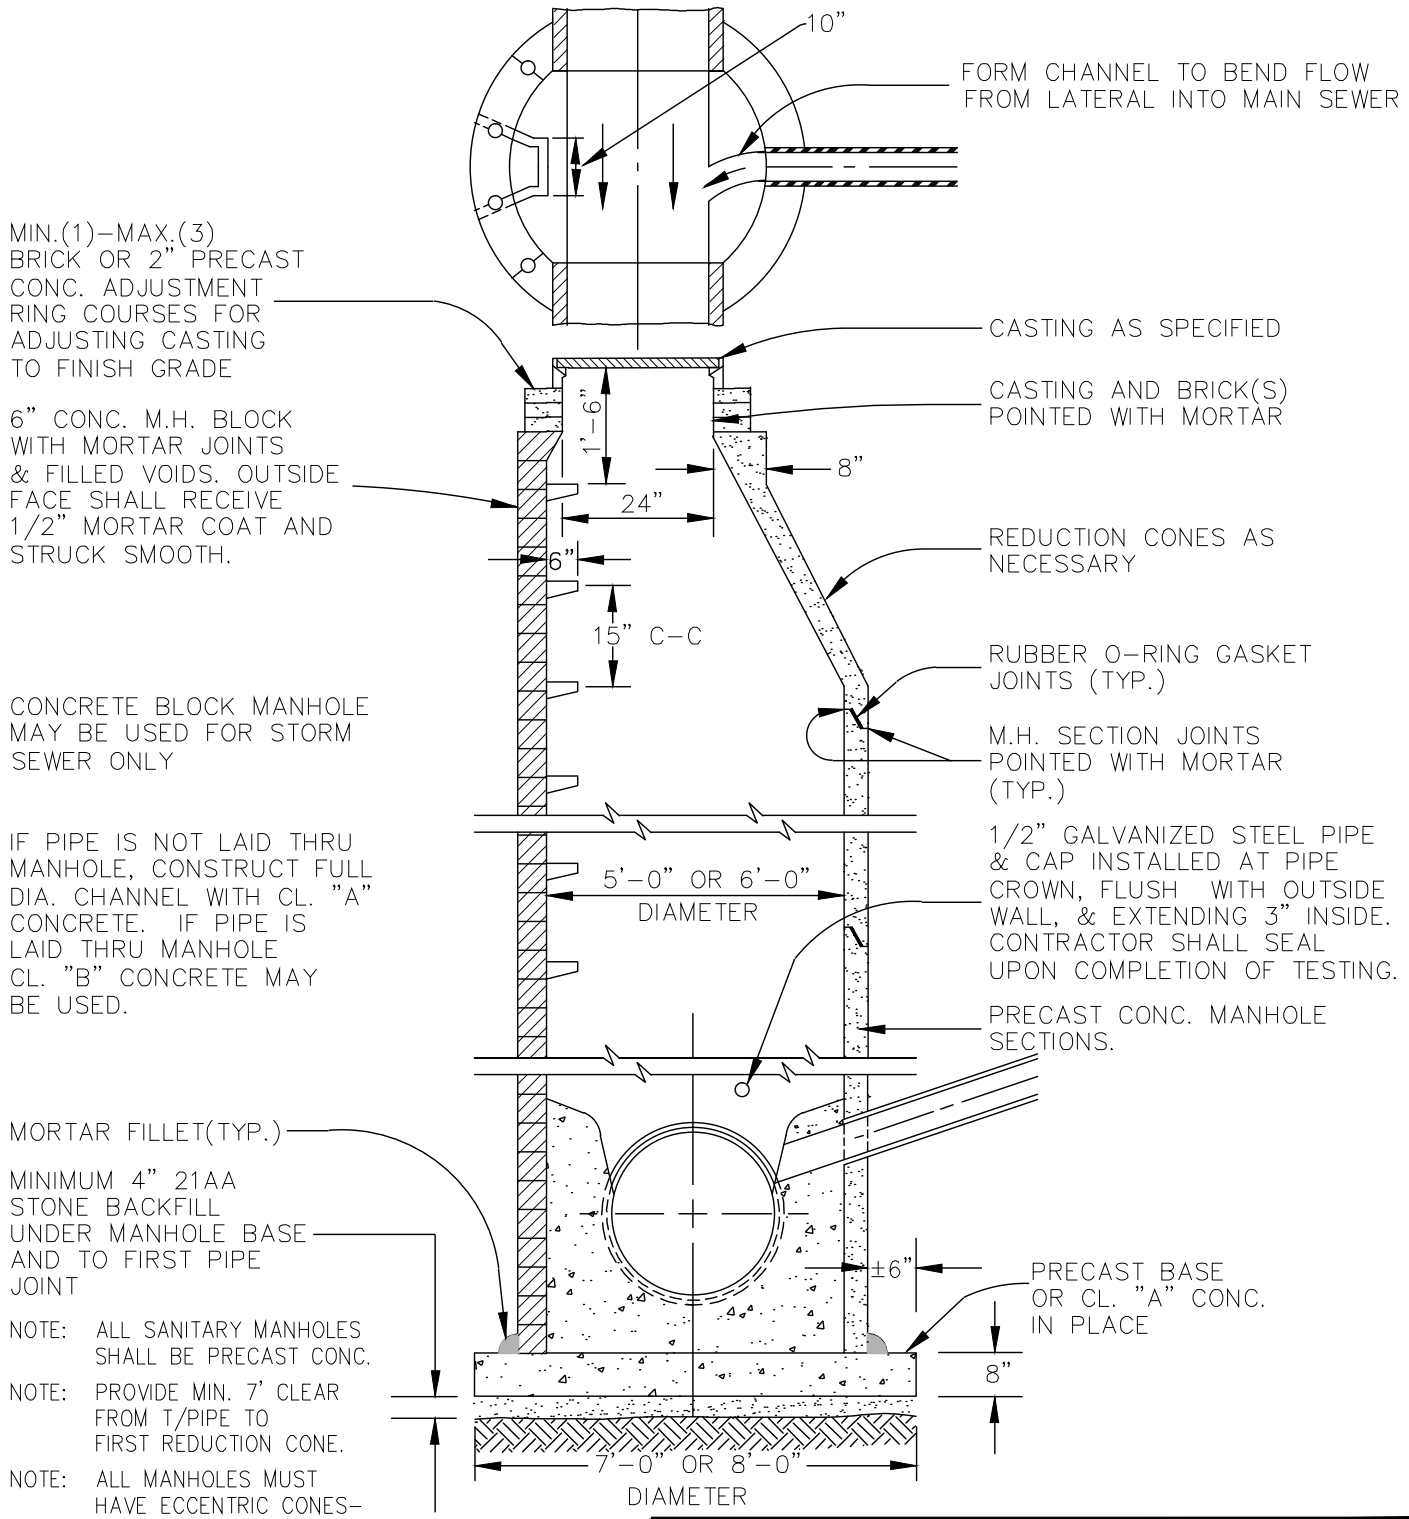

NOTE: ALL SANITARY MANHOLES SHALL BE PRECAST CONC.

NOTE: PROVIDE MIN. 7' CLEAR FROM T/PIPE TO FIRST REDUCTION CONE.

NOTE: ALL MANHOLES MUST HAVE ECCENTRIC CONES– BOTH STORM AND SANITARY.

NOTE: ALL SANITARY SEWER OPENINGS SHALL BE PRECAST WITH RUBBER BOOT CONNECTIONS.

NOTE: CONCRETE BLOCK MANHOLE MAY BE USED FOR STORM SEWER ONLY, AND SHALL BE ECCENTRIC

NOTE: 5' M.H. FOR 36" & 42" SEWERS
6' M.H. FOR 48" & 54" SEWERS

NOTE: NUMBER OF PIPES ALSO DICTATES DIAMETER

REVISIONS	REV. NO.	DR.BY CH. BY	DATE

PUBLIC SERVICES DEPARTMENT
CITY OF ANN ARBOR

STANDARD MANHOLE (TYPE II) FOR 36" TO 54" SEWERS

DR. BY	DF/DCO	**CH. BY**	CSS/DF	**DRAWING NO.** SD–S–2
SCALE	NONE	**DATE**	11–6–92	
INCH	0 ▬ 1			**SHEET NO.** _____ **OF** _____