


1) MIN. 2" X 2" CEDAR TREATED LUMBER, MARKED (SANITARY-RED., STORM-WHITE), SET VERTICALLY.


2) CAP WITH SOLVENT WELDED CAP OR PLUG

3) CLASS "X" CONCRETE TO EXTEND MIN. 1.0' BEYOND TEE OR WYE JOINTS. (D.I.P. TEE OR WYE NOT ENCASED)

4) CLASS II GRANULAR MATERIAL, COMPACTED TO 95% MAXIMUM DENSITY PER CITY OF ANN ARBOR STANDARDS.

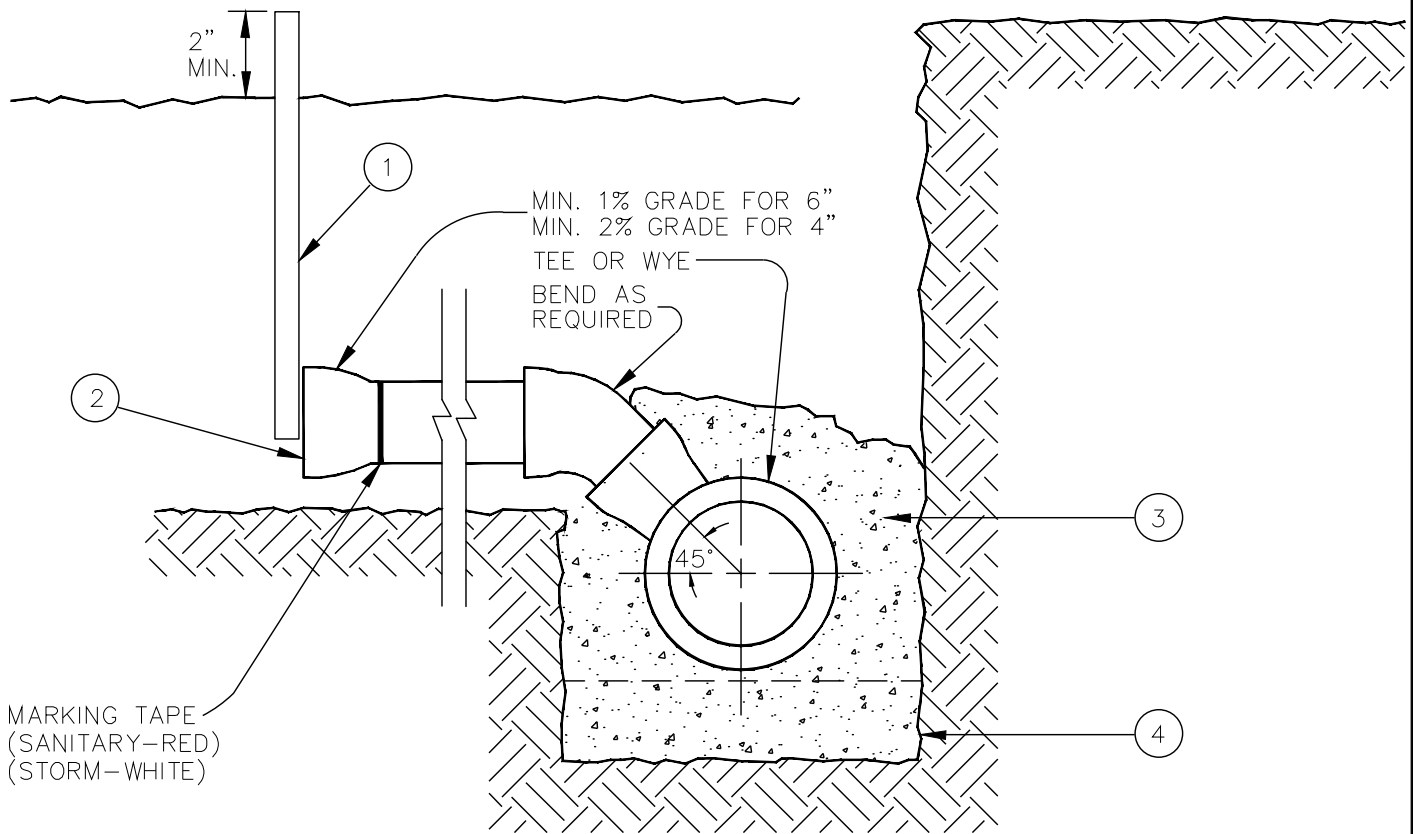

NOTE: TAPS INTO EXISTING SEWERS SHALL BE DONE ONLY BY CITY UTILITIES DEPARTMENT.

REVISIONS		REV. NO.	DR. BY	CH. BY	DATE
PUBLIC SERVICES DEPARTMENT CITY OF ANN ARBOR					
SEWER CONNECTION					
DR. BY	DF/DCO	CH. BY	CSS/DF	DRAWING NO.	
SCALE	NONE	DATE	11-6-92	SD-S-6	
INCH	0  1			SHEET NO. ____ OF ____	