


CLASS "A" CONCRETE THICKNESS AND WIDTH TO MATCH REQUIREMENTS OF CITY STANDARDS FOR SIDEWALKS OR DRIVE APPROACHES, WHICHEVER IS APPLICABLE.

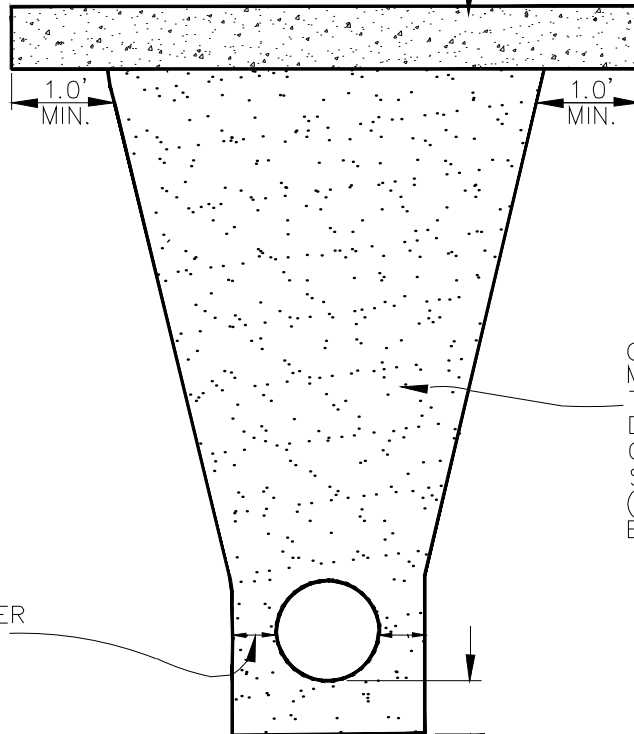

CLASS II GRANULAR MATERIAL COMPACTED TO 95% MAXIMUM DENSITY PER CITY OF ANN ARBOR STANDARDS. (SEE DIVISION IV REGARDING BACKFILL FOR PVC SEWERS)


MIN. TRENCH WIDTH PER CITY OF ANN ARBOR STANDARDS.

MINIMUM PIPE BEDDING PER CITY OF ANN ARBOR SPECIFICATIONS (4" MIN.)

NOTE: TRENCH DETAILS SHOW TYPE OF BACKFILL AND SURFACE RESTORATION ONLY.

NOTE: DENSITY TESTING PER CITY OF ANN ARBOR SPECIFICATION.

NOTE: ALL TRENCHING TO CONFORM TO ALL APPLICABLE M.I.O.S.H.A. STANDARDS.

REVISIONS					REV. NO.	DR. BY	CH. BY	DATE
PUBLIC SERVICES DEPARTMENT CITY OF ANN ARBOR								
UTILITY TRENCH—TYPE VII UNDER SIDEWALK OR DRIVE APPROACH								
DR. BY	DF	CH. BY	CSS	DRAWING NO.				
SCALE	NONE	DATE	11-6-92	SD-TD-7				
INCH	0  1			SHEET NO. ____ OF ____				