

1300T-20AAA BITUMINOUS MATERIAL TO MEET EXISTING THICKNESS (MIN. 2") PLACED AND COMPACTED TO 97% OF THE MARSHALL CONTROL DENSITY.


CLASS "A" HIGH EARLY STRENGTH CONCRETE TO MATCH EXISTING THICKNESS (MIN. 8")

LIMIT OF PAVEMENT PATCH

SAWCUT (TYP.)

HOOK BOLTS-TYP. (PER DETAIL SD-R-5)

5.0' MIN.

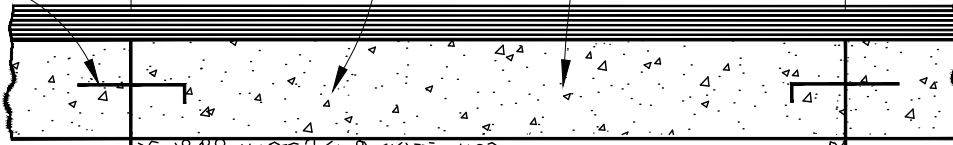

21-AA OR 22-A GRAVEL TO MATCH EXISTING THICKNESS (MIN. 8") COMPACTED TO 98% MAXIMUM DENSITY

1.0' MIN.

1.0' MIN.

CLASS II GRANULAR MATERIAL COMPACTED TO 95% MAXIMUM DENSITY PER CITY OF ANN ARBOR STANDARDS (SEE DIVISION IV REGARDING BACKFILL FOR PVC SEWERS)


MINIMUM TRENCH WIDTH PER CITY OF ANN ARBOR STANDARDS.

MINIMUM PIPE BEDDING PER CITY OF ANN ARBOR SPECIFICATIONS (4" MIN.)

NOTE: DENSITY TESTING PER CITY OF ANN ARBOR SPECIFICATIONS.

NOTE: TRENCH DETAILS SHOW TYPE OF BACKFILL AND SURFACE RESTORATION ONLY.

NOTE: ALL TRENCHING TO CONFORM TO ALL APPLICABLE M.I.O.S.H.A. STANDARDS.

HOOK BOLT REFERENCE CORRECTED					1	NCF	CSS	1-31-94
REVISIONS		REV. NO.	DR. BY	CH. BY	DATE			
PUBLIC SERVICES DEPARTMENT								
CITY OF ANN ARBOR								
UTILITY TRENCH-TYPE IV (UNDER CONCRETE PAVEMENT WITH BITUMINOUS OVERLAY)								
DR. BY	DF	CH. BY	CSS	DRAWING NO.				
SCALE	NONE	DATE	11-6-92	SD-TD-4				
INCH	0  1			SHEET NO. ____ OF ____				